

Emergency Lighting Test Kit

TESELTESTKIT



DESCRIPTION


It is a mandatory legislative requirement that any building or structure that has an emergency evacuation lighting system installed be regularly inspected and maintained in accordance with the requirements AS/NZS 2293.2

This standard sets out the periodic inspection and maintenance procedures which are necessary to ensure that the emergency evacuation lighting system will be in a state of readiness for operation at all times and this maintenance and inspection work only be carried out by persons with suitable qualifications and experience.

Unit discharge tests shall be carried out at six monthly intervals by simulating a mains failure. All luminaires and exit signs shall remain illuminated for the full duration of this discharge test. Any luminaire with a battery that cannot sustain illumination for the full duration of the test shall have this battery replaced and when fully charged retested



Installation Dimensions(mm)

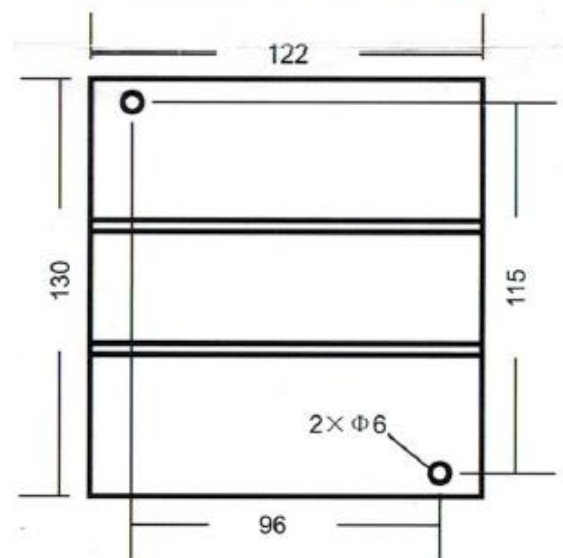

Emergency Lighting Test Kit

TESELTESTKIT



PRODUCT FEATURES

- Control single point system
- Manual or automatic reset
- Simulate supply failure to exit signs in accordance with AS/NZS2293.2
- Key switch operation
- Operating Voltage: 230V AC +/- 5%, 50/60Hz
- Cable Entry 4mm²
- 4 Pole, 25A NC Contactor
- Fully programmable Time Delay
- Operating Temperature 5 to 50°C
- IP Rating IP20

SUPPLIER INFORMATION

Product Code	TESELTESTKIT
Barcode	0793618052652
5 Digit Code	05265
Warranty (Fitting)	5 Years
Box Qty	1
Carton Qty	36
Standards	AS2293.2
Weight (kg)	0.632
Dimensions (mm)	130 X 122 X 96

5 Centre Place WETHERILL PARK NSW 2164

PO Box 3107 | Ph: 1300 287 487 | Email: sales@gtsonline.com.au
gtsonline.com.au