

Mustang Select 12431

LED 2 in 1 Emergency Light

Installation & Maintenance Instruction Manual

Important:

It is illegal for anyone, except for a licensed electrician to install or maintain this product. Before installation, ensure that the electricity supply has been switched off and isolated. Installation must be carried out in accordance with the relevant Australian and International Standards.

Specification:

Operating Supply : 220-240V / 50-60Hz


Compliance: : AS 2293

Viewing : 24m

Mounting : Recessed / Wall Mount / Ceiling Mount

Installation:

Recessed :

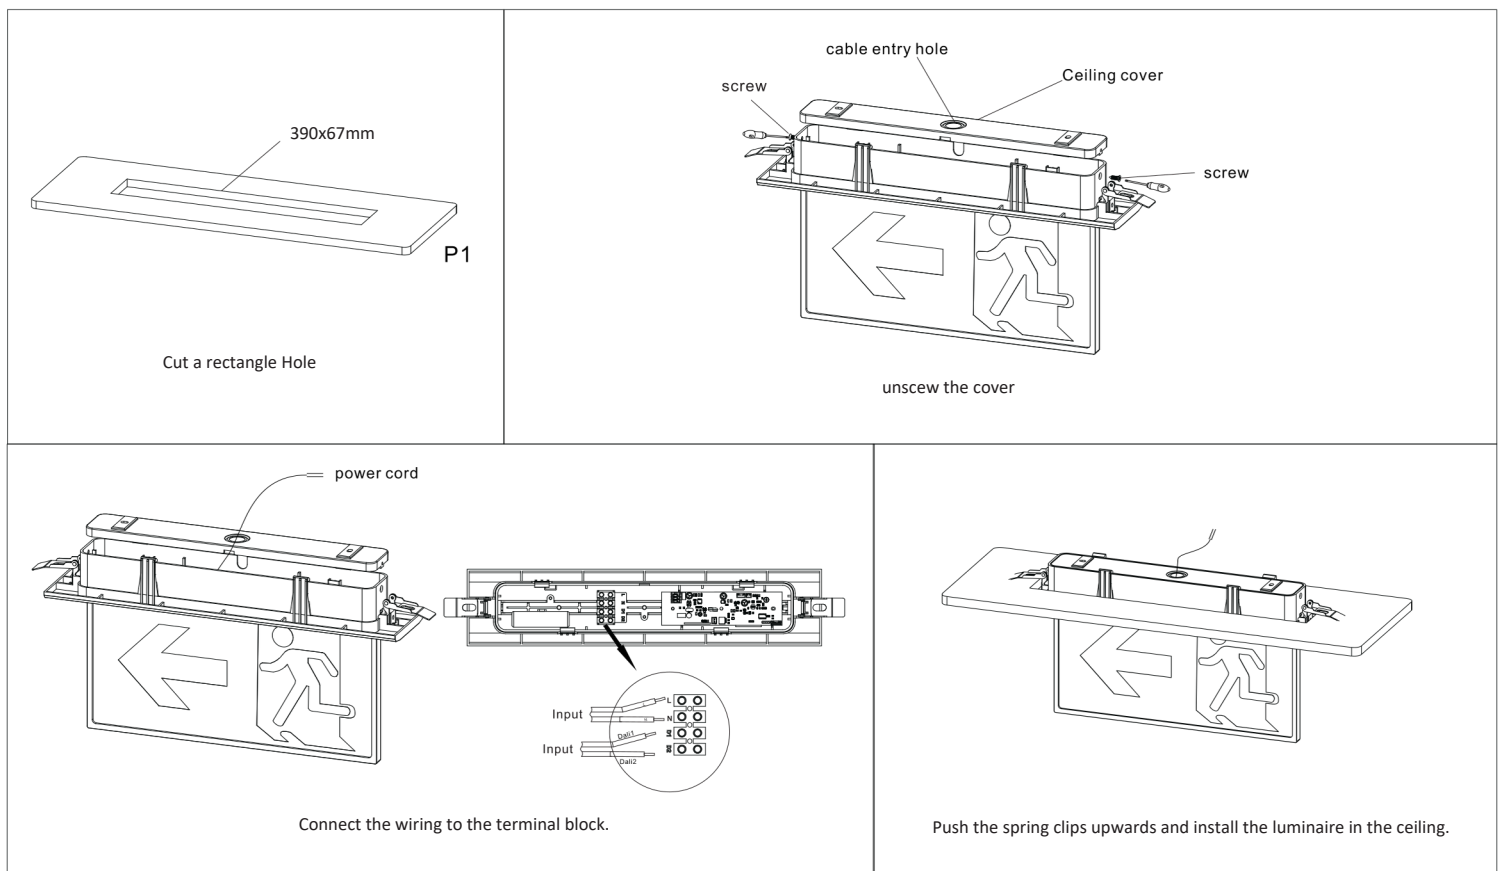

Note:

For first usage, power ON the unit for 24 hours to fully charge the battery. Interrupting the mains supply will discharge the battery.


Testing:

The emergency lamp must illuminate for at least 90mins after disconnection from the mains.

Press and hold Test Button or switch Off Mains Supply, check the emergency lamp is ON.

Released the Test Button or Switch On Mains Supply, check the normal lamp is ON (Maintained operation).

Ceiling Mount

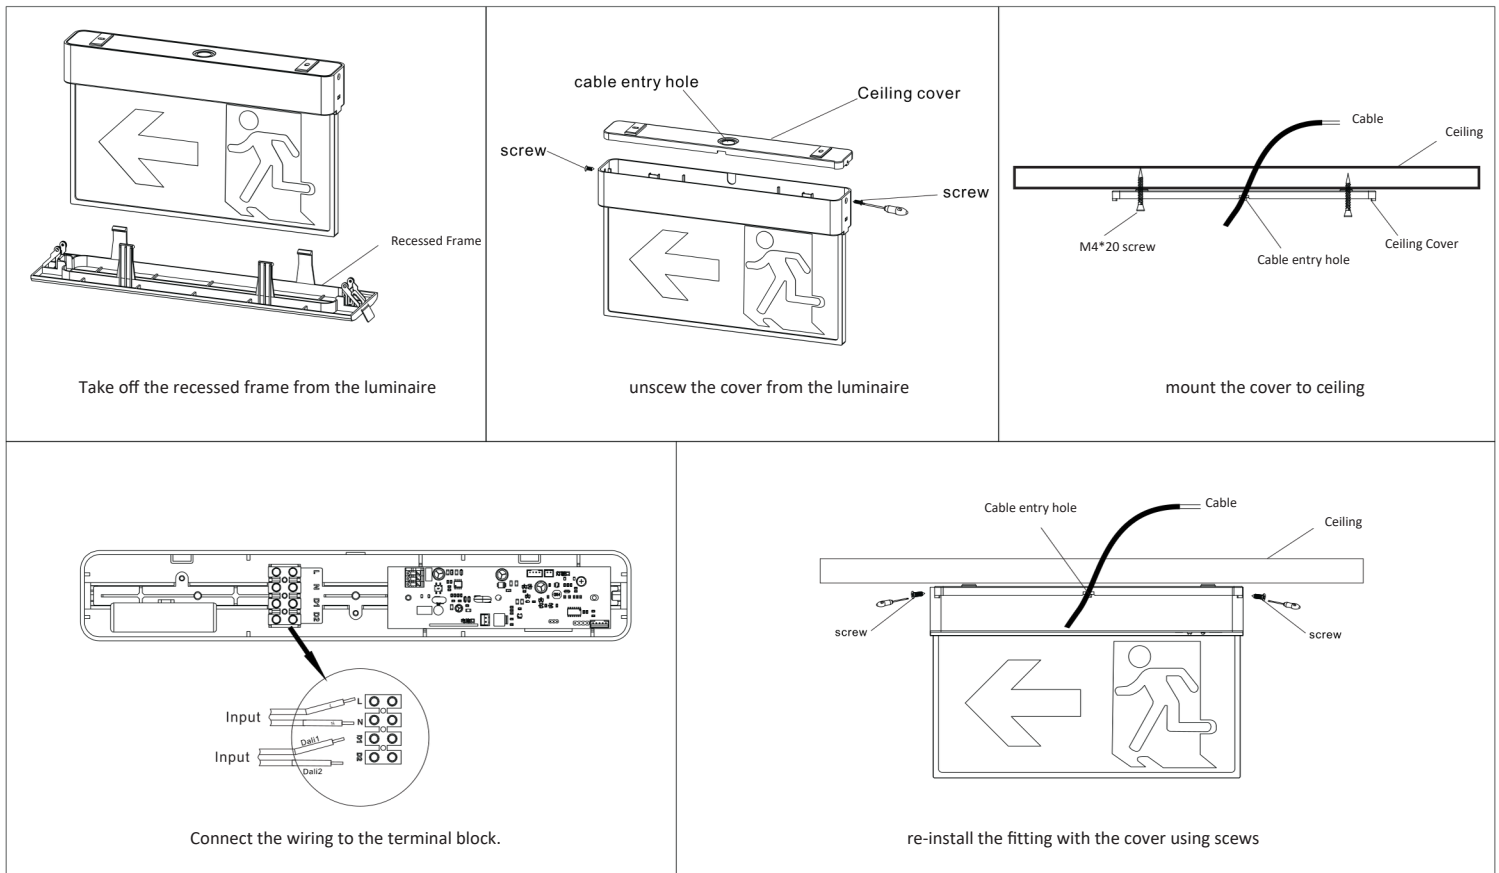

Wall Mount

